

## INSTALLATION


### How to connect the sensors

Connect the sensor provided as shown in the diagram. For remote connections use a standard 0.5-square millimeter two-pole wire, taking great care over the connections, by insulating and sealing the joins carefully. -O.C.- is displayed when the temperature sensor wiring is open, -S.C.- is displayed when the temperature sensor wiring is short circuit.

**How to connect the line**  
Connect line on terminals L-N.

### How to connect the contacts

Output 3-4.....13-14 contacts are N.O. (Normally Opened free of voltage) on which is applicable a 4AMP AC1 maximum load.

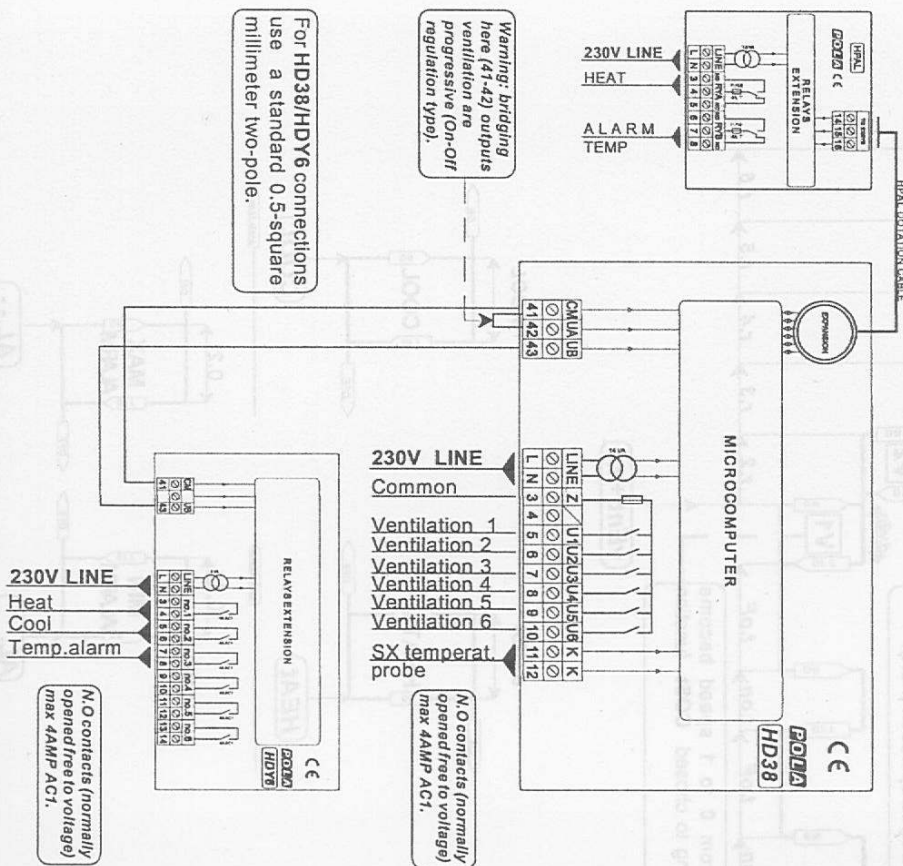

As it is company policy to continually improve the products the Manufacturers reserve the right to make any modifications thereto without prior notice. Their name be held for any damage due to malfunctions


**POLLA**

181013

# HD38

SL 6.0  
6 steps ventilation +thermoregulation

Handbook

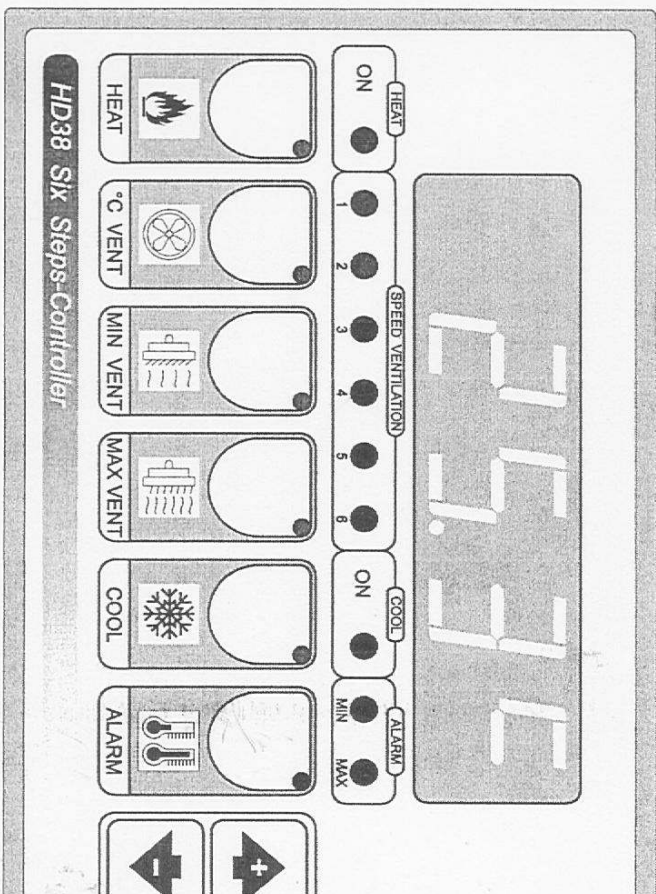

**POLLA**


83QH

83QH

OPERATIVE DIAGRAMS

If Minimum speed is programmed to 0 ( $SP_{min} = 0$ ), when the ventilation is off it's possible to insert a cyclical operation of minimum speed, compound with a time of ventilators turn on ( $t_{on}$ ), with a time of ventilators turn off ( $t_{off}$ ), and with selected speed number during fan's shuttered operation (*Part*).

Step from 0 to 1 speed become according to choiced **COST** function TYPE.

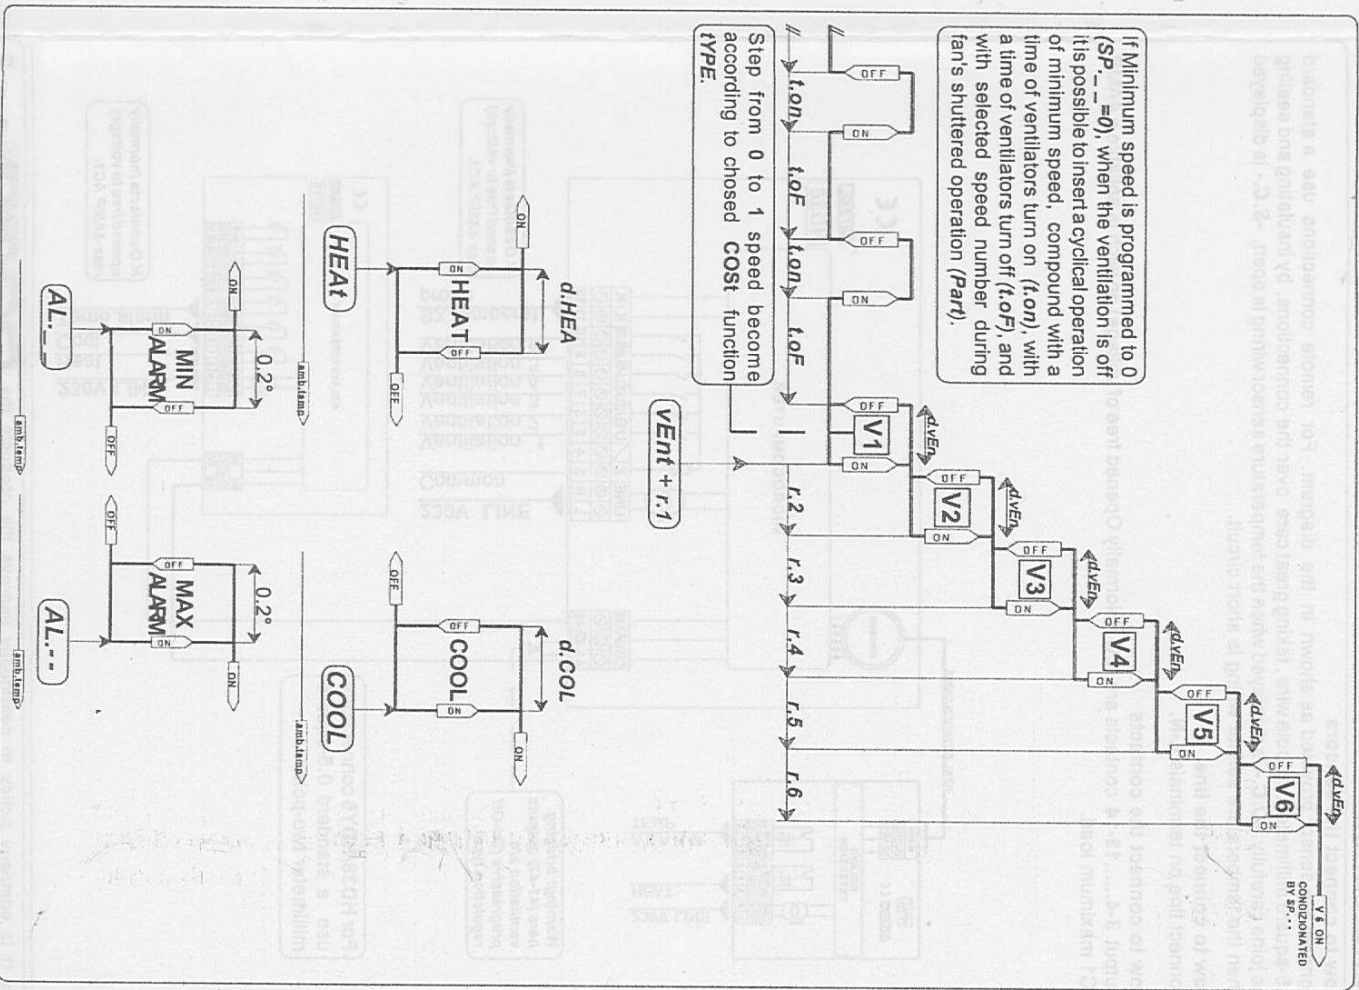

## ALARM PARAMETER SETTING.

Press **ALARM** (key lamp flashes):

This message will be displayed instead of the

%Set Minimum Alarm temperature value.

Press + or - to modify, press **ALARM** to confirm.

AL.

At this point: this message will be displayed instead of the

Set Maximum Alarm temperature value.

Press + or - to modify, press **ALARM** to exit.

AL.

## VIEWING TEMPERATURE RECORDING

Press + : will be displayed followed by

%Maximum Temperature Recording.

Press - : will be displayed followed by

%Minimum Temperature Recording.

Values recorder are memory permanent stored: for memory clear keep pushed + keys

For more than 3 seconds:

CL EA message will be composed on display before clearing operation.

## COST PROGRAMMING (System constants)

These settings refer to the mode of operation of the system and must be made on initial start-up. Press - / + / **HEAT** together at least one second: the message **C.O.S.t.** will be displayed.

The **COST** message are displayed in sequence if you press + to go forward or - to go back.

When you reach the message required (see table below) press + or - to set a new value and then **ALARM** to confirm.

The next system constant will then appear.

You can press **HEAT** to escape and return to the *Run Mode*.



Mess.	Value	Meaning	Note
r.1	0.0°	°C VENT.1 start setting referring to VENT set.	*1)
r.2	1.0°	°C VENT.2 start setting referring to VENT.1 start.	*1)
r.3	1.0°	°C VENT.2 start setting referring to VENT.2 start.	*1)
r.4	1.0°	°C VENT.2 start setting referring to VENT.3 start.	*1)
r.5	1.0°	°C VENT.2 start setting referring to VENT.4 start.	*1)
r.6	1.0°	°C VENT.2 start setting referring to VENT.5 start.	*1)
d.Ven	0.2°	°C Ventilation differential.	*1)
S.Ven	0"	Ventilation step on delay seconds.	
d.HEA	0.2°	°C Heat differential.	*1)
d.COL	0.2°	°C Cool differential.	*1)
time	= 1	t.on and t.oF setting mode (=1 seconds, =2 minutes).	*2)
STEP	= 1	Ventilation setting mode.	*3)
TYPE	= 1	Start ventilation actioning mode.	*4)
TEMP	= 1	Temperature representation (=1 °C, =2 °F).	*5)
Ad.tE	0.0°	°C input sensor temperature correction (+ or -).	*6)

\*1) For more details see *Operative Diagrams*

\*2) **time= 1** : t.on - t.oF setting mode (see **VENT** key) in seconds.  
**time= 2** : t.on - t.oF setting mode (see **VENT** key) in minutes.

\*3) **STEP= 1** : Ventilation in speed regulation mode.  
**STEP= 2** : Ventilation in on-off mode (progression regulator) \*

\* To obtain this type of functioning, the 41-42 terminals has to be connected.

\*4) Different mode of ventilator initial start-up optionally settable useful for speed regulation (step from 0 to 1 speed).  
**TYPE= 1** : 0 to 1 step become in normal mode.  
**TYPE= 2** : 0 to 1 step become with a momentary 10 seconds at speed 2.  
**TYPE= 3** : 0 to 1 step become with a momentary 5 seconds at speed 3.  
**TYPE= 4** : 0 to 1 step become with a momentary 5 seconds at speed 4.

\*5) **TEMP= 1** : °C Temperature range.  
**TEMP= 2** : °F Temperature range.

\*6) You can correct the readings on the sensor (+ or -).

**'KESEI PRUKRAWS (Bootstrap)**

At delivery this processor is ready programmed with the following (Variable) settings.

To return to these settings at any time.

Press + / - / **ALARM** keys together for at least one second:

**boot** message will be displayed.

**HEAT = 20.0°**    **VENT = 25.0°**    **t.on=10"**    **t.OF= 60"**    **PART= 0**  
**SP... = 0**    **SP... = 6**    **COOL=30.0°**    **AL... = 10.0°**    **AL... = 40.0°**  
 \*OST value are shown in **COST** paragraph.

**'HAND MODE"**

Some start-up conditions may be useful to work in "hand" mode.  
 Press + / - / **MIN VENT** keys together for least one second:

**Hand** message will be displayed (release now + key).

Push + until is displayed number required to be handed (see table relays "N° delay") and push **ALARM** for activating relay.

Pushing again + for increase relay number previous relay is deactivated.

You can press **MIN VENT** to escape and return to the *Run Mode*.

**'STATUS INDICATION LAMPS**

The lights situated at the bottom of the display show the state of the various relays set out below.

Lamp	State	N° Relay	Output contacts
HEAT	HEAT On	HPAL 1/HDY6 1	HPAL 3-4/HDY6 3-4
VENT 1	SPEED 1	HD38-1	HD38 3-5
VENT 2	SPEED 2	HD38-2	HD38 3-6
VENT 3	SPEED 3	HD38-3	HD38 3-7
VENT 4	SPEED 4	HD38-4	HD38 3-8
VENT 5	SPEED 5	HD38-5	HD38 3-9
VENT 6	SPEED 6	HD38-6	HD38 3-10
COOL	COOL On	HDY6 2	HDY6 5-6
AL. MIN	MINIMUM ALARM On	HPAL 2/HDY6 3	HPAL 7-8/HDY6 7-8
AL. MAX	MAXIMUM ALARM On	HPAL 2/HDY6 3	HPAL 7-8/HDY6 7-8

Relative light (1-2-3-4-5-6) flash during VENT time cycling, or during *r. Ven* (see *OST*) time delay.

**MAIN SETTINGS (Run Mode)**

**HEAT TEMPERATURE SETTING.**

**HEAT TEMPERATURE SETTING.**

Press **HEAT** (key lamp flashes):

This message will be displayed instead of the

\*Set Heat temperature value.

Press + or - to modify, press **HEAT** to exit.

HEAT

**VENTILATION TEMPERATURE SETTING.**

Press °C VENT (key lamp flashes):

This message will be displayed instead of the

\*Set Ventilation temperature value (start first speed).

Press + or - to modify, press **VENT** to confirm.

VENT

If the minimum speed is set to 0, this message appears instead of the *Set Shutter Running Time* (in seconds or in minutes\*).

Press + or - to modify, press **VENT** to confirm.

F.O.F

At this point: this message will be displayed instead of the *Shutter Dwell Time* (in seconds or in minutes\*).

Press + or - to modify, press **VENT** to confirm.

F.O.F

At this point: this message will be displayed instead of the *Shut Speed Number*.

Press + or - to modify, press **VENT** to exit.

P.P.P.F

**MINIMUM SPEED VENTILATION SETTINGS.**

Press **MIN VENT** :

This message will be displayed instead of the

\*Minimum Ventilation Speed.

Press + or - to modify, press **MIN VENT** to exit.

SP. \_ \_

**MAXIMUM SPEED VENTILATION SETTINGS.**

Press **MAX VENT** :

This message will be displayed instead of the

\*Maximum Ventilation Speed.

Press + or - to modify, press **MAX VENT** to exit.

SP. \_ \_

**COOLING TEMPERATURE SETTINGS.**

Press **COOL** :

This message will be displayed instead of the

\*Set Cool temperature value.

Press + or - to modify, press **COOL** to exit.

COOL

\* See *Cost*, *time* function.